

FIRE DEPARTMENT PERMANENT ACCESS ROADWAY

NOTES:

- 1 THE MAXIMUM GRADIENT OF A FIRE DEPARTMENT ACCESS ROAD SHALL NOT EXCEED 8% (8' IN 100').
- 2 WHERE BUILDINGS ARE LESS THAN 30' IN HEIGHT, A 20' UNOBSTRUCTED WIDTH SHALL BE MAINTAINED ON EITHER SIDE OF THE ACCESS ROADWAY.
- 3 WHERE BUILDINGS ARE MORE THAN 30' IN HEIGHT, A 26' UNOBSTRUCTED WIDTH SHALL BE MAINTAINED ON EITHER SIDE OF THE ACCESS ROADWAY.


DETAIL NO.
G-3244-1

CITY OF GOODYEAR
STANDARD DETAIL

APPROVED: 11/07

FIRE DEPARTMENT PERMANENT ACCESS ROADWAY
TYPICAL CROSS-SECTION

DETAIL NO.
G-3244-1

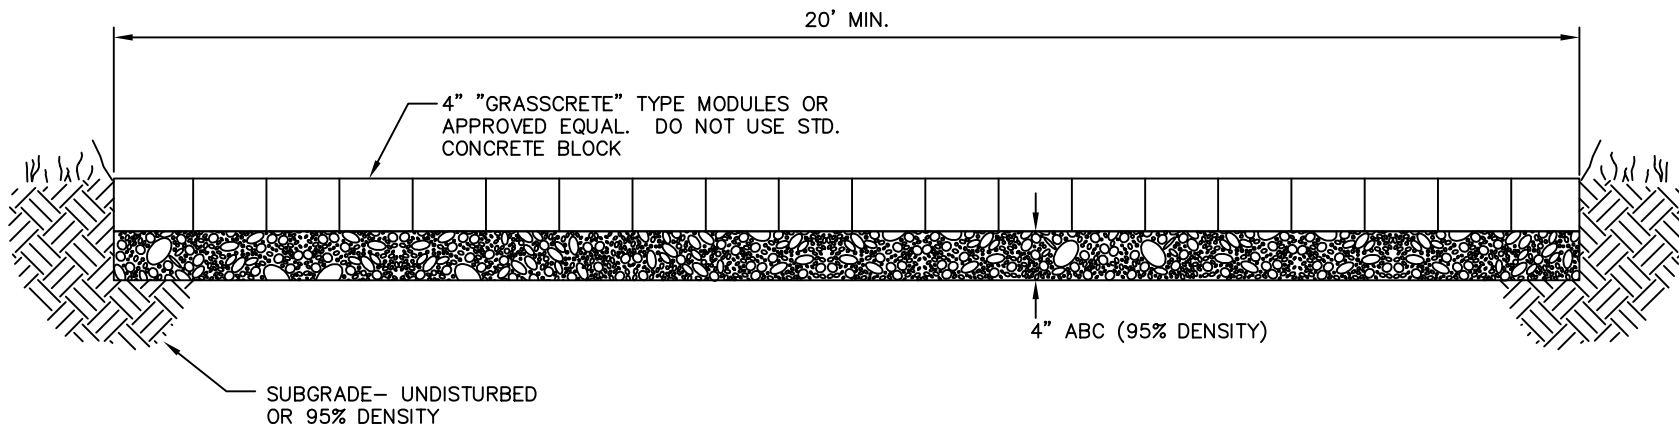


FIRE DEPARTMENT ALTERNATIVE ACCESS ROADWAY

NOTES

- 1 THE MAXIMUM GRADIENT OF A FIRE DEPARTMENT ACCESS ROAD SHALL NOT EXCEED 8% (8' IN 100').
- 2 WHERE BUILDINGS ARE LESS THAN 30' IN HEIGHT, A 20' UNOBSTRUCTED WIDTH SHALL BE MAINTAINED ON EITHER SIDE OF THE ACCESS ROADWAY.
- 3 WHERE BUILDINGS ARE MORE THAN 30' IN HEIGHT, A 25' UNOBSTRUCTED WIDTH SHALL BE MAINTAINED ON EITHER SIDE OF THE ACCESS ROADWAY.
- 4 THIS IS AN ALTERNATIVE CROSS-SECTION TO THE CROSS-SECTION OF THE PERMANENT ACCESS ROADWAY.
- 5 CONSTRUCTION OF THIS ALTERNATIVE IS SUBJECT TO APPROVAL BY THE CITY OF GOODYEAR FIRE DEPARTMENT AND MUST ALSO INCLUDE AN ENGINEERS STAMP AND SIGNATURE.
- 6 DOCUMENTATION THAT THIS CROSS-SECTION WILL SUPPORT FIRE VEHICLE LOADS MUST BE STAMPED AND SIGNED BY A PROFESSIONAL CIVIL ENGINEER AND SUBMITTED TO THE CITY FIRE AND ENGINEERING STAFF FOR REVIEW.

DETAIL NO. G-3244-2	CITY OF GOODYEAR STANDARD DETAIL	APPROVED: 11/07	FIRE DEPARTMENT ALTERNATIVE ACCESS ROADWAY TYPICAL CROSS-SECTION	DETAIL NO. G-3244-2
------------------------	-------------------------------------	-----------------	---	------------------------

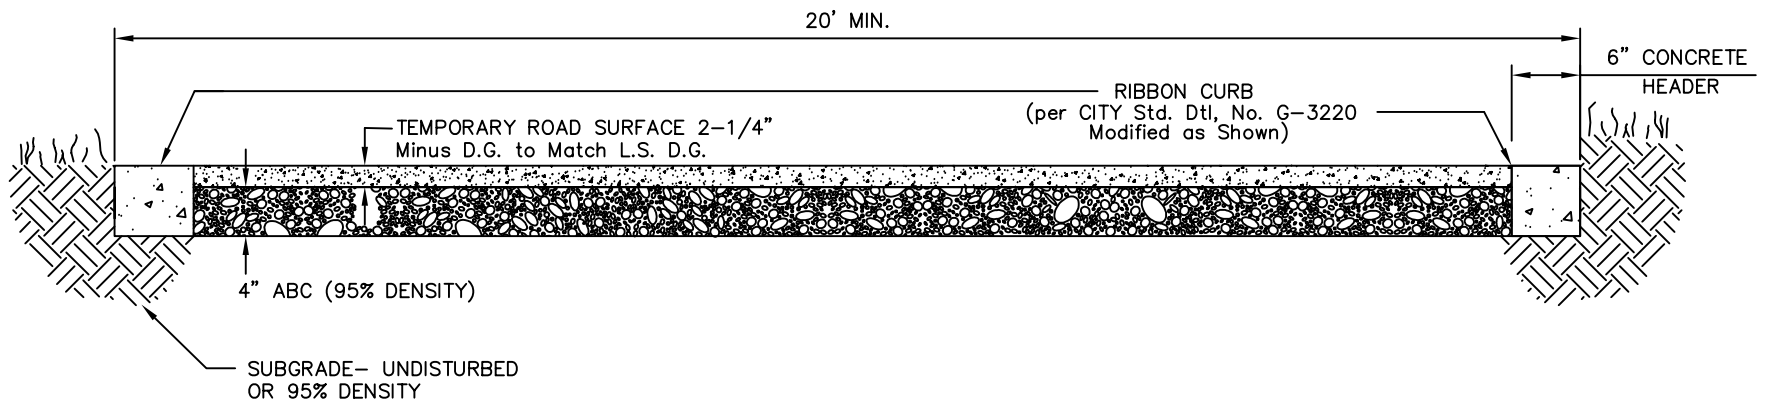

FIRE DEPARTMENT TEMPORARY ACCESS ROADWAY

NOTES

- 1 THE MAXIMUM GRADIENT OF A FIRE DEPARTMENT ACCESS ROAD SHALL NOT EXCEED 8% (8' IN 100').
- 2 WHERE BUILDINGS ARE LESS THAN 30' IN HEIGHT, A 20' UNOBSTRUCTED WIDTH SHALL BE MAINTAINED ON EITHER SIDE OF THE ACCESS ROADWAY.
- 3 WHERE BUILDINGS ARE MORE THAN 30' IN HEIGHT, A 26' UNOBSTRUCTED WIDTH SHALL BE MAINTAINED ON EITHER SIDE OF THE ACCESS ROADWAY.

DETAIL NO.
G-3244-3

CITY OF GOODYEAR
STANDARD DETAIL

APPROVED: 11/07

FIRE DEPARTMENT TEMPORARY ACCESS ROADWAY
TYPICAL CROSS-SECTION

DETAIL NO.
G-3244-3